



Highest level of safety under the most difficult conditions


Fire protection for potentially explosive areas

The Ex Products

Nuclear power



Pharmaceuticals

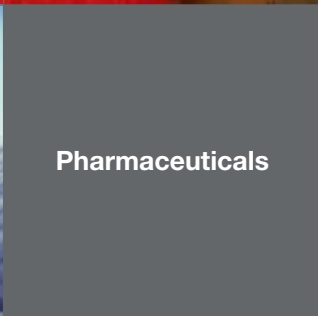

Chemical industries



Logical: The avoidance of flammable materials still represents the easiest form of explosion protection. But in the chemical and pharmaceutical industry as well as other branches of industry, flammable materials are an everyday occurrence. There is no way around it. Flammable gases, mist, and vapors from flammable liquids as well as clouds of flammable dusts can form a dangerous explosive atmosphere in connection with air. In such potentially explosive areas, resources such as electrical and mechanical devices can represent a risk not to be underestimated.

Avoiding such materials is usually difficult since flammable gases, mist, vapors, and also possibly dust are mandatory for the production sequence. The explosion protection in potentially explosive areas focuses on the elimination of possible sources of ignition in potentially explosive atmospheres, including hot surfaces, mechanical and electrical sparks, static electricity, and equalizing currents.

3 types of explosion protection can be fundamentally distinguished: the primary, secondary, and tertiary explosion protection. In primary explosion protection, the formation of a potentially explosive atmosphere is avoided right from the beginning. If this is not possible, which is often the case, the secondary explosion protection method can be used. Suitable resources are used with the aim of making potential ignition sources ineffective in the endangered areas. The third method is called tertiary explosion protection and does not prevent an explosion, but instead restricts its effects, for example through defined decompression via specific opening mechanisms.

The fire protection products represented in the following fall back on the secondary explosion protection methods and prevent a concurrence of ignition source and potentially explosive atmosphere – in a qualified and certified way.

The areas of application of the Ex Products

Paint and varnish processing, gas and liquid-filling machines, plastic production

European Ex Products



In July 2003, the European ATEX guidelines introduced a new classification of danger zones. It distinguishes different potentially explosive atmospheres according to their risk factor. Installed fire detection devices must correspond to these specific requirements. This categorization shows the extent of the necessary measures to be taken. Our Ex Products correspond to this ATEX guidelines.

In the workplace, potentially explosive areas generally show characteristics of zone 1 and 2 as well as zone 21 and 22 at most. Zone 0 and 20 are the exceptions.

Zone 0/20

Areas in which a potentially explosive atmosphere is continuously, over long periods, or frequently present are:

- as a mixture of air and flammable gases, vapors, fogs (**zone 0**)
- in the form of a cloud of flammable dust contained in the air (**zone 20**)

Zone 1/21

Areas in which a potentially explosive atmosphere can sometimes form during normal operation:

- as a mixture of air and flammable gases, vapors, fogs (**zone 1**)
- in the form of a cloud of flammable dust contained in the air (**zone 21**)

Zone 2/22

Areas in which a potentially explosive atmosphere does not usually occur or occurs only short-term during normal operation:


- as a mixture of air and flammable gases, vapors, fogs (**zone 2**)
- in the form of a cloud of flammable dust contained in the air (**zone 22**)

Danger of explosion




Frequency and duration

Danger of explosion

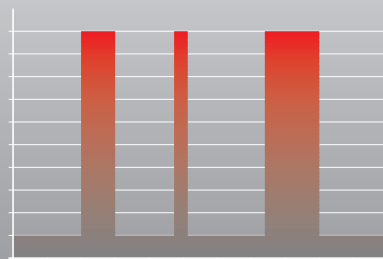

Frequency and duration

Danger of explosion

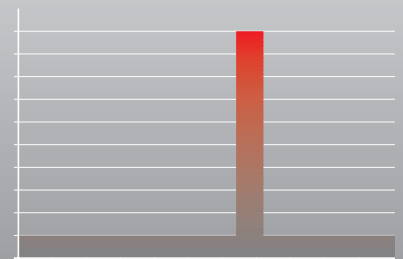

Frequency and duration

e.g. inside reaction vessels

e.g. during the mixing of chemicals

e.g. during storage



Products for operation in potentially explosive areas

Detectors for potentially explosive areas



Automatic point-type fire detector series IQ8Quad Ex (i) without isolator especially for use in explosive environments.
Operation on the esserbus® or on the esserbus®-PLus with individual addressing in connection with Ex-barrier 804744.
Operation as standard detector in connection with Ex-barrier 764744.

Examination Certificate

No.:
TÜV 09 ATEX 554910

EX-protection:

Ex ib IIC T4
Ta: -20 °C to +70 °C

Category: II 2 G

Operation in ex zone 1 and 2 only via Ex-barrier

Part No.: 804744 or 764744

Rate-of-rise Detector IQ8Quad Ex (i)

Part No.:
803271.EX

Automatic heat detector with quick semiconductor sensor for the reliable recognition of fires with fast rate of temperature rise as well as integrated fixed temperature heat function for the recognition of fires with slow temperature rise.

Optical Smoke Detector IQ8Quad Ex (i)

Part No.:
803371.EX

Scattered-light smoke detector for reliable early recognition of fires.

O²T Intelligent Detector IQ8Quad Ex (i)

Part No.:
803374.EX

Intelligent detector with two integrated optical smoke sensors with different scattered-light angles as well as additional heat detector sensor evaluation for the recognition of smouldering fires up to open fires with uniform characteristics.

Detector bases



Detector base
Part No.: 805590

Detector base for the use in connection with the series IQ8Quad Ex (i) explosion-proof fire detectors.

Manual call points



Manual fire alarm
Part No.: 761697
EX-protection:
Ex e d mb IIC T6, T5
Ta: -55 °C to +65 °C (T6)
Ta: -55 °C to +85 °C (T5)
Category: II 2 G
VdS: G297060

Manual fire alarm for the manual activation of a fire alarm and/or danger alarm at explosion-hazardous operating sites.

Type examination certificate: PTB 97 ATEX 3197

Special detectors

**IR flame detector X 9800**

Part No.: 761347
VdS: G203084

The flame detectors are suitable for the detection of smokeless liquid and gas fires as well as for smoke-intensive open fires in explosion-protected areas of zones 1 and 2 as well as zones 21 and 22 which develop for example with the burning of oil products, gases, wood or plastics.

Typical applications can be found in petrochemistry, in turbine halls, and in the automotive industry, among others.

Type examination certificate:

DEMKO 02 ATEX 132195

EX-protection:

EEx d II C T5–T6

Ta: –55 °C to +75 °C (T5)

Ta: –55 °C to +60 °C (T6)

Category: II 2 GD

UV flame detector X 2200

Part No.: 761348
VdS: G203083

Performance features:

- Totally enclosed, pressure-proof housing approved for operation in the Ex zones 1 and 2
- Status display via a 3-colored LED for operation, alarm, and error
- Forwarding of the statuses to the fire detector control panel via 3 integrated relays
- Maintenance by means of magnet with no separate test lamp
- Reliable protection also in the case of difficult environmental conditions (IP 66 protection)
- Microprocessor-controlled, heated optics for the increased safety from moisture and ice
- Reliable immunity to external sources via combined UV/IR evaluation with the X 5200

UV/IR flame detector X 5200

Part No.: 761349
VdS: G203085

Alarm signaling devices

**Ex signaling device**

Part No.: 045040

EX-protection:

EEx ma II T3

Ta: –22 °C to +55 °C

Category: II 3 GD

The Ex signaling device DS 10 has been specially designed for use in industrial environments (zone 2). Its robust die-cast aluminum housing is resistant to environmental influences and chemicals.

**Ex sound generator**

Part No.: 766253

EX-protection:

II 2 G EEx de IIC T4

Category: II 2 G

The Ex sound generator is particularly suitable for use in industrial areas with potentially explosive environments (zone 1 and zone 2). The robust die-cast aluminum housing is resistant to environmental influences and chemicals.

Close-and-retain systems

**Ex magnetic door retainer**

Part No.: 767153

EX-protection:

EEx me II T6

Category: II 2 G

Magnetic door retainer in pressure-proof die-cast housing.


Type examination certificate: ATEX 1778X

Accessories


	<p>Ex-barrier Part No.: 804744</p>	<p>Ex-barrier for the operation of intrinsically safe IQ8Quad Ex (i) series detectors directly on the esserbus® / esserbus®-PLus* with individual addressing in connection with the detector base 805590 in zones 1 and 2. Type examination certificate: BAS 00 ATEX 7087</p>
	<p>Ex-barrier Part No.: 764744</p>	<p>Ex-barrier for the operation of intrinsically safe IQ8Quad Ex (i) series detectors as conventional detectors in connection with the detector base 805590 in zones 1 and 2. Type examination certificate: BAS 01 ATEX 7005</p>
	<p>Isolation block and assembly block Part No.: 764745</p>	<p>For the isolated assembly of the barriers (off-ground) 764744 on standard C rail.</p>
	<p>Housing Part No.: 764752</p>	<p>Housing for the installation of maximum 10 Ex-barriers for the secure operation of intrinsically safe detector groups.</p>
	<p>Cable glands Part No.: 764754</p>	<p>Cable glands for housing 764752.</p>

Applications for early fire detection in potentially explosive areas

Ex-barrier 804744
Operation with individual addressing

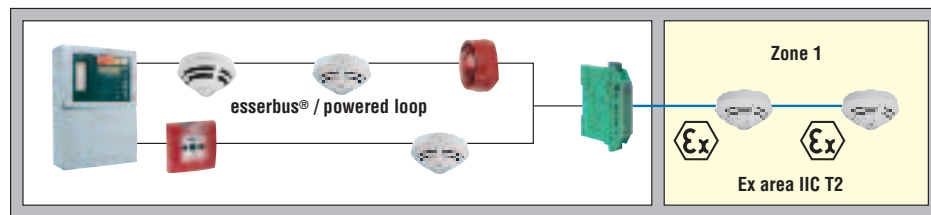

Ex-barrier 764744
Operation with conventional zones

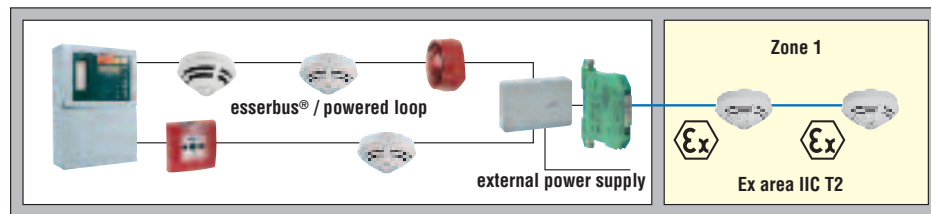

Novar GmbH a Honeywell Company
Dieselstraße 2
41469 Neuss, Germany
Phone: +49 2137 17-0 (Administration)
Phone: +49 2137 17-600 (Customer Service Center)
Fax: +49 2137 17-286
Internet: www.esser-systems.de
E-mail: info@esser-systems.de

Honeywell Life Safety Austria GmbH
Lemböckgasse 49
1230 Vienna, Austria
Phone: +43 1 600 6030
Fax: +43 1 600 6030-900
Internet: www.hls-austria.at
E-mail: hls-austria@honeywell.com

ESSER
by Honeywell

*(esserbus®-PLus = powered loop)